

2002

# Compressor Mechanism Comparison For R744 Application

D. A. Collings

*Tecumseh Products Company*

Z. K. Yap

*Tecumseh Products Company*

D. K. Haller

*Tecumseh Products Company*

Follow this and additional works at: <https://docs.lib.purdue.edu/icec>

---

Collings, D. A.; Yap, Z. K.; and Haller, D. K., "Compressor Mechanism Comparison For R744 Application" (2002). *International Compressor Engineering Conference*. Paper 1526.

<https://docs.lib.purdue.edu/icec/1526>

This document has been made available through Purdue e-Pubs, a service of the Purdue University Libraries. Please contact [epubs@purdue.edu](mailto:epubs@purdue.edu) for additional information.

Complete proceedings may be acquired in print and on CD-ROM directly from the Ray W. Herrick Laboratories at <https://engineering.purdue.edu/Herrick/Events/orderlit.html>

# C9-1

## COMPRESSOR MECHANISM COMPARISON FOR R744 APPLICATION

Douglas A. Collings, P.E., Project Engineer

Zer Kai Yap, Project Engineer

David K. Haller, P.E., Mgr. Adv. Eng.

Tecumseh Products Company, 100 E. Patterson Street  
Tecumseh, MI, 49286, USA

### ABSTRACT

The refrigeration and air conditioning industry shows much interest in environmentally-friendly natural refrigerants. One such refrigerant is R744, carbon dioxide. It is attractive because it is not toxic, not flammable, and is widely available as a byproduct of industrial processes. However, carbon dioxide (CO<sub>2</sub>) systems operate at much higher pressures than systems using HCFC, HFC, or HFC-blend refrigerants. The roles of common compressor mechanisms appear established in the marketplace using current refrigerants, but applicability for CO<sub>2</sub> remains to be seen. The intrinsic properties of scroll, rolling piston, and reciprocating piston mechanisms are compared for their impact on efficiency.

### INTRODUCTION

The refrigeration cycle using CO<sub>2</sub> is transcritical, and is characterized by common pressure ratios but extreme pressure differences acting upon the compressing elements. With this in mind, the three mechanisms are compared to each other using CO<sub>2</sub>, then to HCFC 22 operation as a baseline.

For efficiency comparison the leakage potential, heat transfer potential, and torque are studied. Leakage potential is a quantified as a function of the sealing length and the pressure differential across it, at each point of the compression cycle. Heat transfer is similarly quantified, using surface area and temperature difference. Torque is calculated to make inferences towards motor design.

The time axis was normalized to one compression cycle for comparative purposes.

The pros and cons associated with design details for each mechanism are not considered.

### LEAKAGE

Leakage to and from the compression chamber affects the efficiency of any compressor, and may be even more important in CO<sub>2</sub> application (8).

A rigid compressor model for each mechanism was designed to have equal displacement. Using CO<sub>2</sub>, the scroll was designed for pressures indicative of operation at the ARI540-99 air conditioning condition. Using HCFC 22, the scroll was designed directly for the ARI540-99 air conditioning condition. The criterion selected for comparison to represent the leakage potential of the mechanism is a summation of each sealing line length in the compression chamber multiplied by the difference of the squares of the pressures across this line. This is calculated and plotted for increments through one compression cycle. The reciprocating piston and rolling piston designs are reasonably straightforward to calculate, but the scroll design is more complex, having up to six sealing line and pressure difference combinations to calculate and sum. Raising the pressures acting across a sealing line to a power greater than unity is common in the literature and reference materials (1,8).

Figure 1 presents the results for CO<sub>2</sub> compression. The rolling piston and scroll designs show the greatest potential for leakage during their compression cycles. The scroll plot is somewhat steady. Due to its small number of wraps, the compression chambers tend to be adjacent to suction and discharge. The rolling piston plot shows a sharp drop in leakage potential towards the end of its compression cycle. At this point the leakage into the compression chamber ceases to dominate, and leakage from the compression chamber into the following suction chamber becomes more significant.

Figure 2 presents the results for HCFC 22. Magnitudes of leakage potential are lower due to the lower pressure differences and the lower polytropic exponent. Plots for the rolling piston and reciprocating piston are similar in shape. The scroll mechanism has improved relative to the rolling piston later in its compression cycle. Here, the scroll has a greater number of wraps, and the compression chambers are adjacent to those having closer pressures.

The reciprocating piston has the lowest leakage potential in either case.

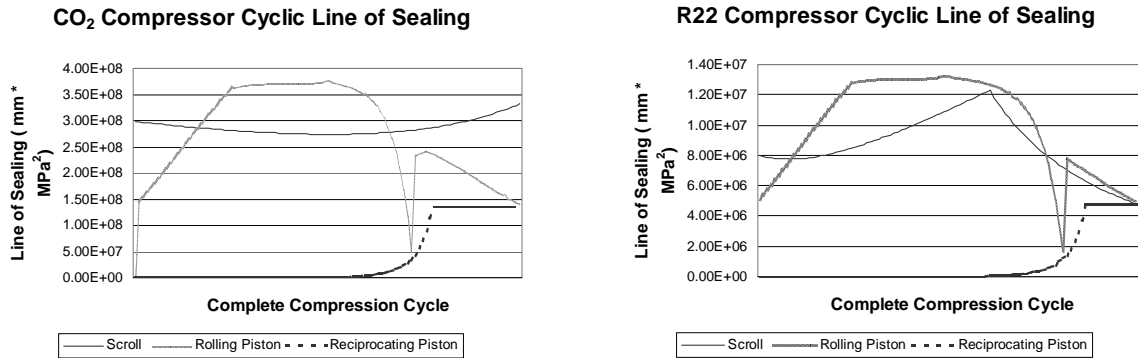


Fig 1. CO<sub>2</sub> Compressor Cyclic Line of Sealing

Fig 2. R22 Compressor Cyclic Line of Sealing

## HEAT TRANSFER

Heat transfer phenomena can affect efficiency also, but the focus here is on keeping discharge temperatures at manageable levels. The ability to transfer heat of compression away from the chamber is viewed as helpful. The chosen criterion to represent heat transfer potential is the surface area of the compression chamber multiplied by the temperature difference across this area. The convective heat transfer coefficient is assumed to be equal for each mechanism with a given refrigerant. It is incrementally calculated similarly to leakage potential, summing all area and temperature difference combinations. To calculate temperature differences for the rolling piston and reciprocating piston designs, the compression chamber temperature is compared to the average temperature of the process. For the scroll, the temperature in the compression chamber is compared to the average temperatures in adjacent chambers.

Figure 3 presents results for CO<sub>2</sub>, and Figure 4 presents results for HCFC 22. Positive values indicate heat transfer potential into the compressing gas. Heat transfer potentials for HCFC 22 are lower, again due to the lower temperature differences and the lower polytropic exponent. The plots for the reciprocating piston and rolling piston designs are similar in shape. These two mechanisms have relatively large chambers exposed to areas that are, on average, tending to be dominated by discharge temperature. In either case, the scroll shows noticeable potential for heat rejection, as the compressing chambers see closer temperatures in adjacent chambers, tending on average not to be dominated by discharge temperature.

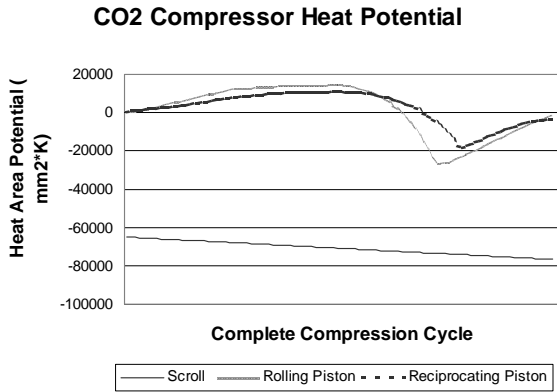


Fig 3. CO<sub>2</sub> Compressor Heat Potential

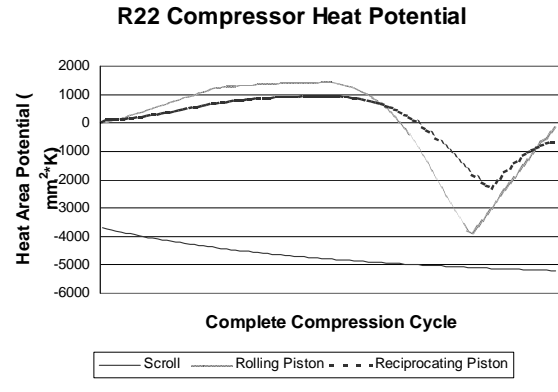


Fig 4. R22 Compressor Heat Potential

## TORQUE

Frictionless torque calculations are presented in Figures 5 and 6. The scroll torque appears flat but has a small peak near its end. Comparing the CO<sub>2</sub> plots to those for HCFC 22, the plots rank the same and scale similarly. Comparing the mechanisms, the difference between rotating and reciprocating designs remains evident. The concern remains that the motor design required for the reciprocating piston's higher starting torque can compromise operating efficiency.

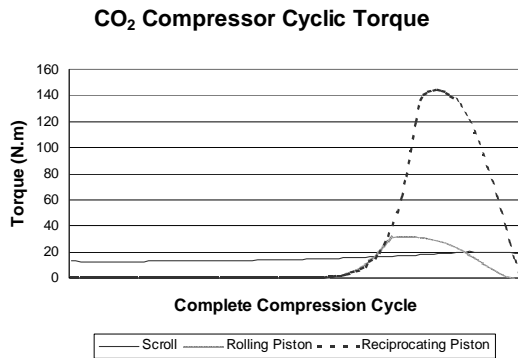


Fig. 5 CO<sub>2</sub> Compressor Cyclic Torque

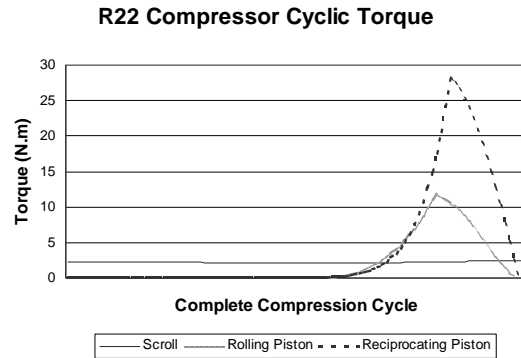


Fig 6. R22 Compressor Cyclic Torque

## CONCLUSIONS

For the design change from conventional HCFC 22 to CO<sub>2</sub>, the scroll shows potential sealing issues. The reciprocating piston had good sealing properties but very high peak torque. The rolling piston had average behavior in all three categories. None of the mechanisms ranked best in all three categories, therefore the success of a compressor in CO<sub>2</sub> application will likely depend on the designer's expertise.

## SPECIAL THANKS

The authors thank Mr. Michael Maertens for his help with computational scroll modeling and simulation.

## REFERENCES

1. Avallone E.A. and Baumeister III T., "Marks Standard Handbook for Mechanical Engineers." McGraw-Hill, Inc. New York, 1996.
2. Gnutek Z., Kalinowski E. and Pietrowicz S., "Analysis of Thermodynamic Processes in the Work Chamber of a Spiral machine in the Function of the Rotation Angle." Proceedings of the 2000 International Compressor Engineering Conference at Purdue, Vol. II pp 815-822, 2000.
3. Hasegawa H., Ikoma M., Nishiwaki F., Shintaku H., and Yakumaru Y., "Experimental and Theoretical Study of Hermetic CO<sub>2</sub> Scroll Compressor." Preliminary Proceedings of the 4<sup>th</sup> IIR-Gustav Lorentzen Conference on Natural Working Fluids at Purdue, pp 347-353, 2000.
4. Holman J., "Heat Transfer", Fourth Ed., McGraw-Hill, Inc. New York.
5. McLinden M., Klein S., Lemmon E., and Peskin A., "REFPROP". NIST Standard Reference Database 23-v. 6.01.
6. Neksa P., Dorin F., Rekstad H., and Bredesen A., "Development of Two-Stage Semi-Hermetic CO<sub>2</sub> Compressors." Preliminary Proceedings of the 4<sup>th</sup> IIR-Gustav Lorentzen Conference on Natural Working Fluids at Purdue, pp 355-362, 2000.
7. Norton, R., "Design of Machinery." McGraw-Hill, Inc. New York, 1994.
8. SuB J. and Kruse H., "Efficiency of the Indicated Process of CO<sub>2</sub>-Compressors." International Journal of Refrigeration, Vol. 21, pp 194-201, 1998.
9. Tadano M., Ebara T., Oda A., Susai T., Takizawa K., Izaki H., and Komatsubara T., "Development of the CO<sub>2</sub> Hermetic Compressor." Preliminary Proceedings of the 4<sup>th</sup> IIR-Gustav Lorentzen Conference on Natural Working Fluids at Purdue, pp 323-330, 2000.
10. Yanagisawa T., Fukuta M., Sakai T., and Kato H., "Basic Operating Characteristics of Reciprocating Compressor for CO<sub>2</sub> Cycle." Preliminary Proceedings of the 4<sup>th</sup> IIR-Gustav Lorentzen Conference on Natural Working Fluids at Purdue, pp 331-338, 2000.
11. Yanagisawa T., Shimizu T., Chu I., and Ishijima K., "Motion Analysis of Rolling Piston in Rotary Compressor." Proceedings of the 1982 International Compressor Engineering Conference at Purdue, pp 185-192, 1982.