

2016

# Enhancement of R1234ze(Z) Pool Boiling Heat Transfer on Horizontal Titanium Tubes for High Temperature Heat Pumps

Ryuichi Nagata

*Kyushu university, Japan, nagata@phase.cm.kyushu-u.ac.jp*

Chieko Kondou

*Nagasaki university, Japan, ckondou@nagasaki-u.ac.jp*

Nobuo Takata

*Kyushu university, Japan, takata@cm.kyushu-u.ac.jp*

Shigeru Koyama

*Kyushu university, Japan, koyama@cm.kyushu-u.ac.jp*

Follow this and additional works at: <http://docs.lib.purdue.edu/iracc>

---

Nagata, Ryuichi; Kondou, Chieko; Takata, Nobuo; and Koyama, Shigeru, "Enhancement of R1234ze(Z) Pool Boiling Heat Transfer on Horizontal Titanium Tubes for High Temperature Heat Pumps" (2016). *International Refrigeration and Air Conditioning Conference*. Paper 1666.

<http://docs.lib.purdue.edu/iracc/1666>

This document has been made available through Purdue e-Pubs, a service of the Purdue University Libraries. Please contact [epubs@purdue.edu](mailto:epubs@purdue.edu) for additional information.

Complete proceedings may be acquired in print and on CD-ROM directly from the Ray W. Herrick Laboratories at <https://engineering.purdue.edu/Herrick/Events/orderlit.html>

## Enhancement of R1234ze(Z) Pool Boiling Heat Transfer on Horizontal Titanium Tubes for High-Temperature Heat Pumps

Ryuichi NAGATA<sup>1</sup>, Chieko KONDOU<sup>2\*</sup>, Shigeru KOYAMA<sup>1,3</sup>

<sup>1</sup> Kyushu University, Interdisciplinary Graduate School of Engineering Science  
Fukuoka, Japan

<sup>2</sup> Nagasaki University, Graduate School of Engineering  
Nagasaki, Japan  
(ckondou@nagasaki-u.ac.jp)

<sup>3</sup> Kyushu University, International Institute for Carbon-Neutral Energy Research  
Fukuoka, Japan  
(koyama@phase.cm.kyushu-u.ac.jp)

### ABSTRACT

R1234ze(Z), which has a global warming potential of less than 1, is a promising alternative refrigerant for high-temperature heat pumps designed for heat recovery in the industrial sector. The use of titanium as the material for heat exchangers exposed to acid exhaust is one solution to prevent oxidation. In this study, the pool boiling heat transfer characteristics outside of horizontal titanium tubes were experimentally investigated for R1234ze(Z). A plain tube and three enhanced titanium tubes were tested at saturation temperatures from 10 to 60 °C and heat fluxes from 0.55 to 79.8 kW m<sup>-2</sup>. Compared to the plain tube, the tested enhanced tube exhibited a 2.8 to 5.1 times higher heat transfer coefficient, on average, in the test range, which could compensate for the disadvantage in the thermal conductivity of titanium. The enhancement ratio predominantly depends on the saturation temperature and the wall heat flux. At conditions of higher saturation temperatures and lower heat fluxes, where smaller bubbles are observed, test tubes with smaller opening width exhibit higher heat transfer coefficients. The experimental results indicate the importance of fin geometry optimization to the operation conditions.

### 1. INTRODUCTION


The low GWP (global warming potential) refrigerant R1234ze(Z) is a promising candidate refrigerant for use in industrial high-temperature heat pumps (Brown et al., 2009). To reduce primary energy consumption, high-temperature heat pumps are applicable as heat recovery systems to assist steam boilers in the drying process of wood or paint, the distillation process of beverages, and the cleaning process of machined components (Kondou and Koyama, 2015). In large-scale heat pumps, shell-and-tube heat exchangers made of copper are most widely used. However, the heat exchangers of such heat pumps designed for waste heat recovery systems are often exposed to exhaust containing acidic substances. Using titanium as the material is one solution to prevent oxidation in the polluted exhaust. Titanium is also advantageous to reduce the weight of large heat exchangers for shipping and installation and to reduce costs if the wall thickness is sufficiently reduced relative to copper tubes. As comprehensively reviewed (e.g., Pate et al., 1990, Webb, 1994; Thome, 2006), numerous enhancement techniques have been patented and some have been applied to the pool boiling of the shell-and-tube heat exchangers. The most common technique is a surface with dense re-entrant cavities produced by a mechanically deformed copper low-finned tube. Similar attempts were made with the titanium tubes in this study.

The pool boiling heat transfer characteristics outside of enhanced, horizontally oriented, titanium tubes are experimentally investigated for R1234ze(Z). A plain tube and three enhanced tubes with different re-entrant cavities are tested in a pressure vessel, and the boiling behavior is observed to determine the optimum tube geometry for R1234ze(Z) at relatively higher saturation temperatures for waste heat recovery.

## 2. EXPERIMENTS

### 2.1 Experimental setup

Fig. 1 shows the experimental apparatus used to characterize the R1234ze(Z) pool boiling outside the titanium tubes. This apparatus consists of cooling and heating water loops connected to temperature control baths and a refrigerant loop of natural circulation driven by gravity. The main components of the refrigerant loop are a condenser and an evaporator. In the evaporator, the horizontally oriented test tube is immersed in liquid R1234ze(Z) that flows down from the condenser; meanwhile, heating water flows through the test tube. The test tubes are observed through a glass window set in the evaporator during the experiment. The temperature of liquid R1234ze(Z) is measured by thermocouples near the test tube to confirm the state can be justified as saturation. The inlet and outlet temperatures of the heating water are measured in the mixing chambers by Pt thermometers with uncertainty of  $\pm 0.05$  K. The volumetric flow rate is measured with a gear type meter installed in the water loop with uncertainty of  $\pm 0.5\%$  of the reading value. The temperature change in the heating water over the test tube is kept at 3 K to suppress the tube wall temperature distribution within 2 K. The tube wall temperature is measured by an electric resistance method. As illustrated in Fig. 1 (b), the test tube is electrically insulated by an applied constant direct current. The voltage drop of test tube over the heat transfer length is measured and correlated to the tube wall temperature. From the calibration, it was confirmed that the correlation of the voltage drop is proportional to the temperature and is able to predict the temperature within  $\pm 0.1$  to 0.2 K for each test tube. The saturation pressure of R1234ze(Z) is adjusted by controlling the temperature and flow rate of the cooling water delivered to the condenser and is measured by an absolute pressure transducer within  $\pm 0.14$  kPa. The heat flux condition is adjusted by controlling the flow rate of the heating water. The active heat transfer length of the test tube is 400 mm; the resistance (voltage drop) measurement length is 396 mm. Table 1 lists the dimensions of the test tubes; two plain tubes made of copper and titanium and three enhanced titanium

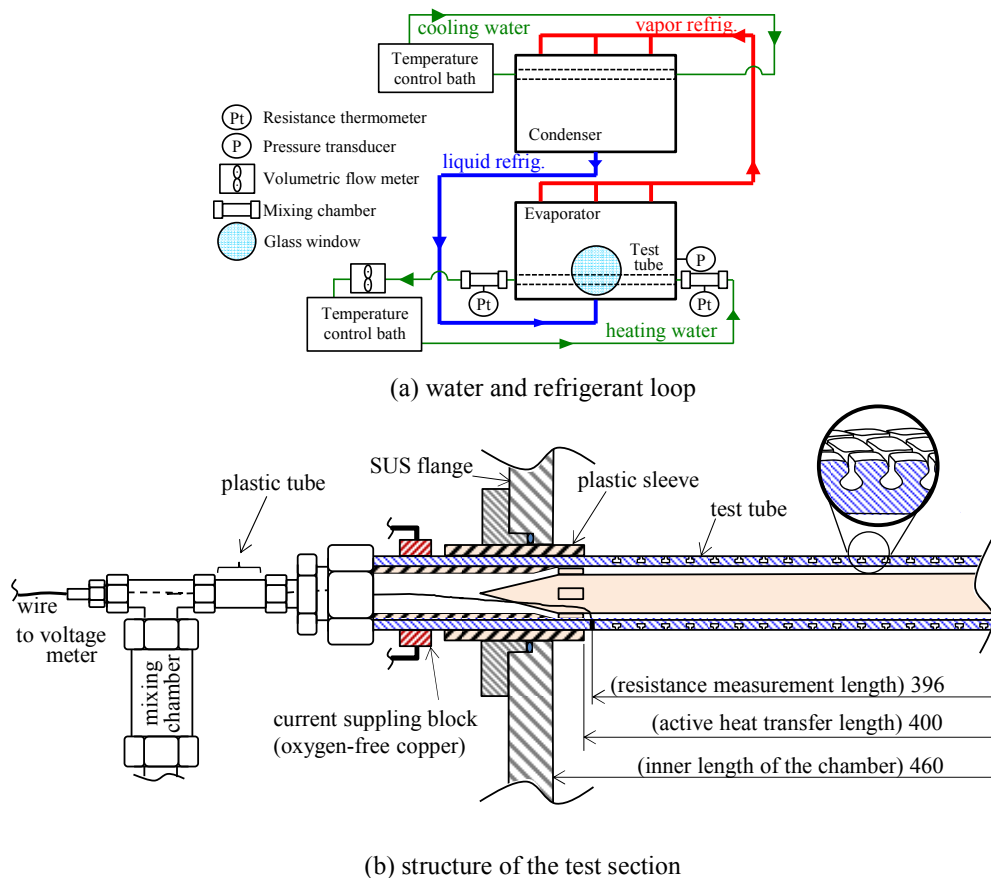

**Figure 1: Experimental apparatus**

**Table 1 Dimensions of the test tubes**

	plain-Cu	plain-Ti	TE01	TE02	TE03
outer/fin tip diameter $D_o$ , mm	19.12	19.06	18.54	18.66	18.66
inner diameter $D_i$ , mm	16.92	15.01	15.35	15.35	15.18
wall thickness, $\delta$ , mm	1.1	2.0	1.6	1.7	1.7
fin-root diameter $D_{root}$ , mm	-	-	16.10	17.83	15.96
surface roughness $R_a$ , $\mu\text{m}$	0.39	0.63	-	-	-
fin height, mm		-	0.37	0.41	0.39
axial fin pitch, mm		-	0.70±0.04	0.74±0.03	0.73±0.02
circumferential fin pitch, mm		-	0.73±0.01	0.72±0.01	0.73±0.01
open mouth		-	narrow	->	wide
thermal conductivity, $\lambda_{tube}$ $\text{Wm}^{-1}\text{K}^{-1}$	385	18.9	18.9	18.9	18.9

tubes TE01, TE02, and TE03 were used. The open mouth width of tube TE01 is the narrowest and that of TE03 is the widest.

## 2.2 Data reduction

The heat transfer rate over the test tube is obtained from the heat balance of the heating water as,

$$Q_{\text{H}_2\text{O}} = \dot{V}_{\text{H}_2\text{O}} \rho_{\text{H}_2\text{O}} (h_{\text{H}_2\text{O},i} - h_{\text{H}_2\text{O},o}) - Q_{\text{loss}} \quad (1)$$

where,  $h_{\text{H}_2\text{O},i}$  and  $h_{\text{H}_2\text{O},o}$  are the enthalpy of the heating water obtained from the measured bulk mean temperature at the inlet and outlet of the test tube.  $Q_{\text{loss}}$  is the heat leaked to the ambient, which is correlated to the temperature difference between the heating water and ambient air. The average heat flux  $q_{\text{wall}}$  is defined with the outer surface for the plain test tube and with the apparent outer surface at the fin tip diameter for the enhanced tubes.

$$q_{\text{wall}} = Q_{\text{H}_2\text{O}} / (\pi D_o L) \quad (2)$$

where,  $L$  is the active heat transfer length of 400 mm.

The tube wall temperature  $T_{\text{wall},m}$  measured by the resistance method is assumed to correspond to the average wall temperature over the internal surface to the fin root. Considering the heat conduction through the tube wall, the reference tube wall temperature at the fin root  $T_{\text{wall}}$  is corrected by the following equation.

$$T_{\text{wall}} = T_{\text{wall},m} - \frac{Q_{\text{H}_2\text{O}} \ln(D_{\text{root}}/D_m)}{2\pi\lambda_{\text{tube}}L}, \quad D_m = \frac{(D_{\text{root}} + D_i)}{2} \quad (3)$$

For the plain tube, the fin root diameter  $D_{\text{root}}$  is substituted by the outer diameter  $D_o$ .  $\lambda_{\text{tube}}$  is the thermal conductivity of the tube wall. For the copper tube, the value  $385 \text{ W m}^{-1}\text{K}^{-1}$  is applied. For titanium tubes, the value provided from the manufacturer of  $18.9 \text{ W m}^{-1}\text{K}^{-1}$  is applied in this study.

Finally, the average heat transfer coefficient (HTC) is given as,

$$\alpha = q_{\text{wall}} / (T_{\text{wall}} - T_{\text{sat}}) \quad (4)$$

where  $T_{\text{sat}}$  is the saturation temperature of R1234ze(Z). The thermodynamic and transport properties of R1234ze(Z) and water are calculated by REFPROP 9.1 (Lemmon *et al.*, 2013).

## 3. RESULTS AND DISCUSSION

### 3.1 Plain tubes – copper and titanium tubes

First, the differences between copper and titanium tubes are compared with the experimental results of plain tubes. As listed in Table 1, the distinct differences of these two tubes are the surface roughness, wall thickness, and thermal conductivity. Because the extensibility of the titanium alloy is not as high as that of copper alloy, the surface of titanium tubes tends to be much rougher than that of copper tubes. On rougher surfaces, the presence of larger embryonic bubble diameters produced by increased vapor entrapment in the micro cavities primarily enhances nucleate boiling (Rainey and You, 2000). However, the thicker tube wall and lower thermal conductivity of titanium

tubes increases the thermal resistance over the tube wall. The thermal resistance of the copper tube and titanium tubes ( $\delta / \lambda_{\text{tube}}$ ) are approximately  $2.86\text{E-}06 \text{ Wm}^{-2}\text{K}^{-1}$  and  $105.8\text{E-}06 \text{ Wm}^{-2}\text{K}^{-1}$ , respectively. The thermal resistance of the titanium tube is 37 times that of the copper tube, which completely compensates for the advantage of surface roughness. For copper tubes, the temperature difference from the internal to outer surface is approximately 0.05 K. Thus, the tube wall thermal resistance is negligible, comparing to the boiling site. For the test titanium tube, at a heat flux of  $20 \text{ kWm}^{-2}$  and a saturation temperature of  $30 \text{ }^\circ\text{C}$ , the temperature difference between the internal and outer surfaces is 1.9 K. Under these conditions, the average wall superheat,  $T_{\text{wall}} - T_{\text{sat}}$ , is 3.9 K. Therefore, the tube wall thermal resistance takes 33% of the resistance from the internal surface to the boiling site. Therefore, for titanium tubes, reducing the tube wall thickness with consideration of corrosion is important.

Fig. 2 shows the experimentally quantified pool boiling HTC on plain tubes of copper and titanium at saturation temperatures  $T_{\text{sat}}$  of 10, 30, and  $60 \text{ }^\circ\text{C}$  as a function of the heat flux. The horizontal and vertical bars appended to the symbols indicate the measurement uncertainty of 95 % coverage (Taylor, 1997). As plotted in Fig. 2, at a saturation temperature of  $10 \text{ }^\circ\text{C}$ , HTC on the titanium tube is higher than that of the copper tube. At a saturation temperature of  $60 \text{ }^\circ\text{C}$ , the HTC of the copper tube exceeds that of the titanium tube. The increased ratio of the HTC to heat flux of the copper tube is greater than that of the titanium tube. Therefore, the HTC of the copper tube is more sensitive to the saturation temperature and heat flux than that of the titanium tube.

In Fig. 2, the correlations of Gorenflo et al. (2010) and Ribatski-Jabardo (2003) are also plotted.

Gorenflo et al. (2010): 
$$\alpha = \alpha_0 F_{q_{\text{wall}}} F_{p_{\text{red}}} F_R F_{\text{wm}} \tag{5}$$

where,  $\alpha_0 = 3.58 \left[ \left( \frac{dp}{dT} \right)_{\text{sat}} / \sigma \right]^{0.6}$  at  $p_{\text{red}} = 0.1$ .  $F_{q_{\text{wall}}} = (q_{\text{wall}} / q_{\text{wall}0})^{(0.95 - 0.3 p_{\text{red}}^{0.3})}$ ,  $q_{\text{wall}0} = 20 \text{ [kWm}^{-2}\text{]}$ .

$$F_{p_{\text{red}}} = 0.7 p_{\text{red}}^{0.2} + 4 p_{\text{red}} + (1.4 p_{\text{red}}) / (1 - p_{\text{red}}). \quad F_R = (R_a / R_{a0})^{2/15}, \quad R_{a0} = 0.4 \text{ [}\mu\text{m]}.$$

$$F_{\text{wm}} = \left[ (\rho_{\text{tube}} c_{\text{tube}} \lambda_{\text{tube}}) / (\rho_{\text{Cu}} c_{\text{Cu}} \lambda_{\text{Cu}}) \right]^{0.25}.$$

Ribatski-Jabardo (2003): 
$$\alpha = f_{\text{wm}} (q_{\text{wall}}^{0.9 - 0.3 p_{\text{red}}^{0.2}}) p_{\text{red}}^{0.45} [-\log(p_{\text{red}})]^{-0.8} R_a^{0.2} M^{-0.5} \tag{6}$$

where  $M$  is the molar mass of the refrigerant. The material parameters are recommended as  $f_{\text{wm}}=100$  for copper,  $f_{\text{wm}}=110$  for brass, and  $f_{\text{wm}}=85$  for stainless steel. For the titanium tube,  $f_{\text{wm}}$  is assumed as 90 because the thermophysical properties of titanium alloy are similar to stainless steel. For instance, the temperature diffusivities of copper alloy, titanium alloy, and stainless steel are, respectively,  $95, 6.7, \text{ and } 4.1 \text{ mm}^2\text{s}^{-1}$ . Additionally, it was numerically found that the bias is minimized at a material parameter  $f_{\text{wm}}$  of 90.6.

Table 2 compares the selected correlations to the experimental results for the copper tube and the titanium tubes. The relative bias,  $\bar{\varepsilon}$ , and the standard deviation  $S$  are introduced to quantify the degree of agreement.

$$\bar{\varepsilon} = \frac{1}{N} \sum_{j=1}^N \varepsilon_j = \frac{1}{N} \sum_{j=1}^N \left( \frac{\alpha_{\text{exp}} - \alpha_{\text{cal}}}{\alpha_{\text{cal}}} \times 100 \right) \text{ [%]} \tag{7}$$

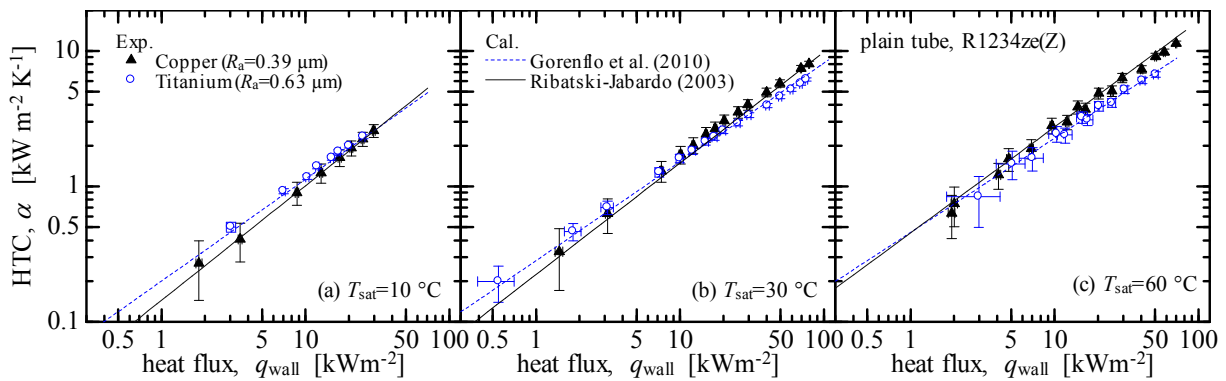


Figure 2: Variation of R1234ze(Z) pool boiling HTC on the test plain tubes of copper and titanium.

**Table 2: Comparison with predicting correlations for the copper and titanium plain tubes**

	the copper tube ( $N=79$ )		the titanium tube ( $N=36$ )	
	$\bar{\varepsilon}$ [%]	$S$ [%]	$\bar{\varepsilon}$ [%]	$S$ [%]
Stephan-Abdelsalam (1980)	33.6	24.5	20.4	9.2
Jung et al. (2003)	8.7	17.2	-2.9	10.5
Ribatski-Jabardo (2003)	12.0	13.3	0.7	5.8
Gorenflo et al. (2010)	4.0	7.9	93.9	38.6

$$S = \sqrt{\frac{1}{N} \sum_{i=1}^N (\varepsilon_i - \bar{\varepsilon})^2} \quad [\%] \quad (8)$$


where  $N$  is the number of data. Among the selected correlations, the correlations of Gorenflo et al. (2010) and Ribatski-Jabardo (2003) show the best agreement with the experimental HTC for the copper tube and the titanium tube, respectively. Nevertheless, the Gorenflo et al. (2010) correlation considerably deviates from the experimental HTC of the titanium tube because the  $f_{wm}$  in Eq. (5) is not validated for titanium. Some material inherent properties affect nucleate boiling. For instance, temperature diffusivity determines the recovery speed of the wall superheat of the spot where the nucleate bubble departed. The surface energy determines the wettability and wickability and affects the shape of nucleate bubbles. To discuss the effects of the material dependence on nucleate HTC, a further approach and comprehensive database are needed.


### 3.2 Enhanced titanium tubes

Fig. 3 shows the variation of R1234ze(Z) pool boiling HTC on the enhanced titanium tubes: TE01, TE02, and TE03 at saturation temperatures of 10, 30, and 60 °C. TE01 has the narrowest open-mouth of the small tunnels underneath the fin-tip surface; TE03 has the widest open-mouth. The symbols indicate the experimental HTC of the enhanced tubes, whereas the dashed line indicates the predicted HTC by Ribatski-Jabardo (2003) of the titanium plain tube.

The enhanced tube TE01 with narrowest open-mouth exhibits much higher HTC than the plain tube, even at lower heat flux. At saturation temperatures of 10 and 30 °C, TE01 shows a slight decrease in HTC with increasing heat flux. At a saturation temperature of 60 °C, the HTC of TE01 increases at heat fluxes up to 10 kWm<sup>-2</sup> and then plateaus. This HTC behavior of TE01 completely differs from the plain tube. In contrast, the enhanced tube TE03 shows similar tendency to the plain tube. The HTC of TE03 monotonically increases with increasing heat flux. At heat fluxes above 50 kWm<sup>-2</sup>, the HTC increment ratio to heat flux seems to decrease slightly. Thus, under the conditions of higher heat fluxes, the HTC of TE03 exceeds that of TE01.

Fig. 4 compares the HTC enhancement ratio based on the titanium plain tubes,  $\alpha_{\text{enhanced}} / \alpha_{\text{plain}}$ , between TE01, TE02, and TE03. The parenthesized numbers in the symbol legend indicate the average value of the plotted. The enhancement ratio ranges widely from 13 to 2. Over the entire range of the experiment, the tested tubes yield an enhancement ratio more than double. The enhancement ratio is significant at lower heat flux; then, the ratio decreases as the heat flux increases. The tunnel structures are beneficial at the early stage of nucleate boiling. The decrement is greater for TE01

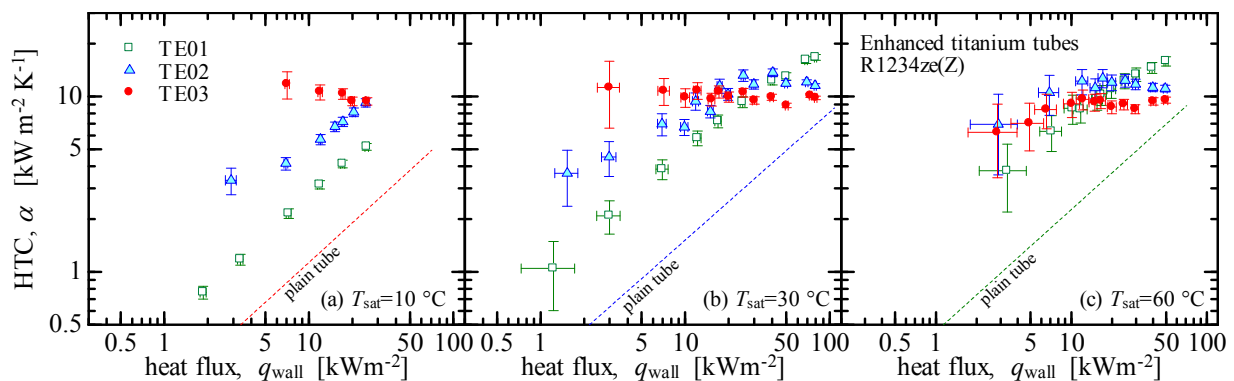**Figure 3: Variation of R1234ze(Z) pool boiling HTC on the enhanced titanium tubes.**

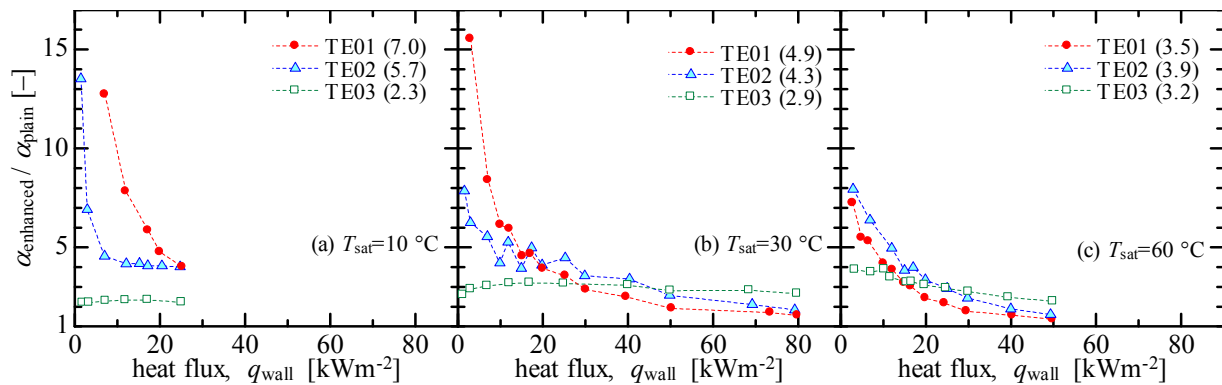

**Figure 4: HTC enhancement ratio based on the plain tube. (The parentheses contain the average value.)**

but much moderate for TE03, therefore the rank of enhancement ratio is interchanged between TE01 and TE03. In general, at lower saturation temperatures, most fluids show lower nucleate boiling HTC mainly due to their greater surface tension. Under such conditions, the tunnel structures of the narrow open-mouth are more beneficial to enhance boiling heat transfer.

As mentioned above, the narrow open-mouth is advantageous at lower heat flux and lower saturation temperatures. From the observation of the bubble behavior, the following results are found. Because the narrow open-mouth eases the holding of liquid refrigerant in the tunnels and increases the degree of superheat in the micro cavities inside the tunnels, this geometry yields acceleration of the boiling incipience and the nucleate boiling. However, at higher heat fluxes, the bubbles are generated faster and they stretch out in the tunnels until they depart from the tunnel open-mouth. The narrow open-mouth interferes with the emerging vapor in the tunnels and the ingress of liquid to the tunnels. Most likely, some portion of the internal surface of the tunnels is dried-out. Thus, the enhancement ratio of the boiling heat transfer drastically decreases. These findings coincide with some remarks in previous studies by Nakayama et al. (1980a and b) and also by Chien and Webb (1998a, b, and c)

#### 4. CONCLUSIONS

Pool boiling heat transfer characteristics outside of horizontal titanium tubes were investigated for industrial high-temperature heat pumps designed for waste heat recovery. The R1234ze(Z) pool boiling heat transfer coefficients on a plain tubes and three enhanced tubes were experimentally quantified. The main findings are the following:

- On titanium tubes, thermal resistance over the tube wall is considerably large due to lower thermal conductivity. Thus, reducing the tube wall thickness with consideration of corrosion is important when using titanium tubes.
- Among the selected correlations, Gorenflo et al. (2010) showed the best agreement with the experimental data of the copper plain tube. Nevertheless, this correlation considerably deviated from the data of titanium plain tubes because the material parameter used in this correlation is not valid for titanium tubes. The Ribatski-Jabardo (2003) correlation with a material parameter of 90 has the best agreement with the titanium plain tube.
- Enhanced titanium tubes with tunnels produced by mechanically deforming low-finned tubes exhibited HTC enhancement ratios based on the titanium plain tube from 13 to 2 over the entire experimental range. The open-mouth significantly changed the enhancement ratio. To optimize this parameter for a refrigerant, the saturation temperature and heat flux are important.
- At lower saturation temperatures and lower heat fluxes, the enhanced tube with the narrowest open-mouth had the highest HTC. The narrower open-mouth eases the holding of liquid and increases the degree of superheating in the tunnels, which accelerates the boiling incipience and nucleate boiling.
- At higher saturation temperatures and higher heat fluxes, the enhanced tube with the widest open-mouth had the highest HTC. The wide open-mouth helps emerging bubbles to depart from the tunnels and the ingress of liquid into the tunnels.

## NOMENCLATURE

$D_i$	inner diameter	(m)
$D_o$	outer diameter	(m)
$D_{root}$	fin root diameter	(m)
$L$	active heat transfer length	(m)
$M$	molar mass	(g mol <sup>-1</sup> )
$N$	number of data	(-)
$Q$	heat transfer rate	(W)
$R_a$	arithmetic mean surface roughness	( $\mu$ m)
$S$	standard deviation	(%)
$T$	temperature	(°C)
$\dot{V}$	volumetric flow rate	(m <sup>3</sup> s <sup>-1</sup> )
$c$	specific heat	(J kg <sup>-1</sup> )
$h$	specific enthalpy	(J kg <sup>-1</sup> )
$p$	pressure	(Pa)
$p_{red}$	reduced pressure	(-)
$q$	heat flux	(W m <sup>-2</sup> )
$\alpha$	heat transfer coefficient, HTC	(W m <sup>-2</sup> K <sup>-1</sup> )
$\delta$	tube thickness	(m)
$\bar{\varepsilon}$	relative bias	(%)
$\lambda$	thermal conductivity	(W m <sup>-1</sup> K <sup>-1</sup> )
$\rho$	density	(m <sup>3</sup> kg <sup>-1</sup> )
$\sigma$	surface tension	(Nm <sup>-1</sup> )

### Subscript

H2O	water
i	inlet
o	outlet
loss	heat loss
wall	tube wall
m	average, middle
tube	test tube
Cu	copper
0	reference value
sat	saturation state
H2O	water
cal	calculated
exp	experimental

## REFERENCES

- Brown, J.S., Zilio, C., Cavallini, A. (2009). The fluorinated olefin R-1234ze(Z) as a high-temperature heat pumping refrigerant. *Int. J. Refrig.*, 32, 1412–1422.
- Chien, L.H., Webb, R.L. (1998a). Visualization of pool boiling on enhanced surface. *Exp. Therm. Fluid Sci.*, 16, 332-341.
- Chien, L.H., Webb, R.L. (1998b). A parametric study of nucleate boiling on structured surfaces, Part1: Effect of tunnel dimensions”, *Trans. ASME, J. Heat Transf.*, 120, 1042-1048.
- Chien, L.H., Webb, R.L. (1998c). A parametric study of nucleate boiling on structured surfaces, Part2: Effect of pore diameter and pore pitch”, *Trans. ASME, J. Heat Transf.*, 120, 1049-1054.
- Gorenflo, D., Baumhögger, E., Windmann, T., Herres, G., (2010). Nucleate pool boiling, film boiling and single-phase free convection at pressures up to the critical state. Part I: Integral heat transfer for horizontal copper cylinders. *Int. J. Refrig.*, 33, 1229–1250.
- Jung, D., Kim, Y., Ko, Y., Song, K., (2003). Nucleate boiling heat transfer coefficients of pure halogenated refrigerants. *Int. J. Refrig.*, 26, 240–248.



- Kondou, C., Koyama, S. (2015). Thermodynamic assessment of high-temperature heat pumps using Low-GWP HFO refrigerants for heat recovery. *Int. J. Refrig.*, 53, 126–141.
- Lemmon, E.W., Huber, M.L., McLinden, M.O. (2013). Reference Fluid Thermodynamic and Transport Properties - REFPROP Ver. 9.1. National Institute of Standards and Technology, Boulder, CO, USA.
- Nakayama, W., Daikoku, T., Kuwahara, H., Nakajima, T. (1980a). Dynamic model of enhanced boiling heat transfer on porous surfaces. Part1: Experimental investigation, *Trans. ASME, J. Heat Transf.*, 102, 445-450.
- Nakayama, W., Daikoku, T., Kuwahara, H., Nakajima, T. (1980b). Dynamic model of enhanced boiling heat transfer on porous surfaces. Part2: Analytical modeling, *Trans. ASME, J. Heat Transf.*, 102, 451-456.
- Pate, M.B., Ayub, Z.H., Kohleer, J., (1990). Heat Exchangers in the Air Condition and Refrigeration Industry, *Compact Heat Exchangers*, Shah, R.K., Kraus, A.D., Metzger, D.E., eds., Hemisphere, New York, 567-590.
- Rainey, K.N., You, S.M. (2000). Pool Boiling Heat Transfer From Plain and Microporous, Square Pin-Finned Surfaces in Saturated FC-72. *Int. J. Heat Transf.*, 122, 509-516.
- Ribatski, G., Jabardo, J.M.S., (2003). Experimental study of nucleate boiling of halocarbon refrigerants on cylindrical surfaces. *Int. J. Heat Mass Transf.* 46, 4439 - 4451.
- Stephan, K., Abdelsalam, M. (1980). Heat-Transfer Correlations for Natural Convection Boiling. *Int. J. Heat Mass Transf.*, 23, 73–87.
- Taylor, J.R. (1997). An introduction to error analysis, second ed. University science book, 73-77.
- Thome, J.R. (2006). Ch. 9: Boiling Heat Transfer on External Surfaces. *Engineering Data Book III*, Wolverine Tube, Inc., 1-38.
- Webb, R.L. (1994). Ch. 11, *Principles of Enhanced Heat Transfer*, NY, Wiley.

### ACKNOWLEDGEMENT

The present study is sponsored by the project on the "Development of High Efficiency and Non-Freon Air Conditioning Systems" of the New Energy and Industrial Technology Development Organization (NEDO) Japan. The tested refrigerant R1234ze(Z) was kindly supplied by Central Glass Co., Ltd. The tested tubes were kindly provided by Shinko Metal Products Co., Ltd.